

TABLE 10-A—MINIMUM EGRESS REQUIREMENTS<sup>1</sup>

USE <sup>2</sup>	MINIMUM OF TWO MEANS OF EGRESS ARE REQUIRED WHERE NUMBER OF OCCUPANTS IS AT LEAST	OCCUPANT LOAD FACTOR <sup>3</sup> (square feet)
		× 0.0929 for m <sup>2</sup>
1. Aircraft hangars (no repair)	10	500
2. Auction rooms	30	7
3. Assembly areas, concentrated use (without fixed seats) Auditoriums Churches and chapels Dance floors Lobby accessory to assembly occupancy Lodge rooms Reviewing stands Stadiums Waiting area	50	7
4. Assembly areas, less-concentrated use Conference rooms Dining rooms Drinking establishments Exhibit rooms Gymnasiums Lounges Stages Gaming: keno, slot machine and live games area	50	15
5. Bowling alley (assume no occupant load for bowling lanes)	50	4
6. Children's homes and homes for the aged	6 [for SFM] 7	80
7. Classrooms	50	20
8. Congregate residences	10	200
9. Courtrooms	50	40
10. Dormitories	10	50
11. Dwellings	10	300
12. Exercising rooms	50	50
13. Garage, parking	30	200
14. Health care facilities— Sleeping rooms Treatment rooms	8 [for SFM] 7 10 [for SFM] 7	120 240
15. Hotels and apartments	10	200
16. Kitchen—commercial	30	200
17. Library— Reading rooms Stack areas	50 30	50 100
18. Locker rooms	30	50
19. Malls (see Chapter 4)	—	—
20. Manufacturing areas	30	200
21. Mechanical equipment room	30	300
22. Nurseries for children (day care)	7	35
23. Offices	30	100
24. School shops and vocational rooms	50	50
25. Skating rinks	50	50 on the skating area; 15 on the deck
26. Storage and stock rooms	30	300
27. Stores—retail sales rooms Basements and ground floor Upper floors	50 50	30 60
28. Swimming pools	50	50 for the pool area; 15 on the deck
29. Warehouses <sup>5</sup>	30	500
30. All others	50	100
31. Group R, Division 2	10	300 <sup>6</sup>
32. Group R, Division 6	10	—

<sup>1</sup>Access to, and egress from, buildings for persons with disabilities shall be provided as specified in Chapter 11.

<sup>2</sup>For additional provisions on number of exits from Groups H and I Occupancies and from rooms containing fuel-fired equipment or cellulose nitrate, see Sections 1007.4, 1007.5 and 1007.7, respectively.

<sup>3</sup>This table shall not be used to determine working space requirements per person.


<sup>4</sup>Occupant load based on five persons for each alley, including 15 feet (4572 mm) of runway.

<sup>5</sup>Occupant load for warehouses containing approved high rack storage systems designed for mechanical handling may be based on the floor area exclusive of the rack area rather than the gross floor area.

<sup>6</sup>The number of clients for occupancy classification shall be determined by the licensing authority.



OAKLAND FIRE DEPARTMENT  
 Fire Prevention Bureau  
 250 Frank H. Ogawa Plaza, Suite 3341  
 Oakland, CA 94612-2032  
 PHONE (510) 238-3851  
 FAX (510) 238-6739  
 TTY/TDD (510) 238-6384

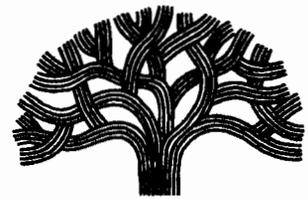

## FIRE FALSE ALARM BILLING APPEAL FORM

False Alarm Location Address - APN: \_\_\_\_\_

Invoice #: \_\_\_\_\_ Invoice Due Date: \_\_\_\_\_

Owner Information \_\_\_\_\_ Phone: \_\_\_\_\_

Fax: \_\_\_\_\_

**Please give a brief explanation below of your reason for appealing the payment of this invoice. You may attach additional pages as required.**

.....

.....

.....

.....

.....

.....

.....

.....

.....

\_\_\_\_\_  
 Owner/Agent Signature

\_\_\_\_\_  
 Date

**Your appeal will be automatically DENIED and the City's collection actions will continue if the Fire Prevention Bureau does not receive your appeal in writing at our office (address shown above) within 15 business days from the postmarked date shown on the mailing envelope or fax masthead you received with this form.**

*Date Requested:* \_\_\_\_\_