

THE INSCRIPTION "CITY OF OAKLAND - ELECTRICAL" SHALL BE CAST IN ALL CURB BOX COVERS.

NON-PORTLAND CONCRETE CEMENT COVER SHALL BE FURNISHED WITH LIFTING SLOTS BUT WITHOUT HOLD-DOWN BOLTS.

MINIMUM CURB BOX COVER CORNER RADIUS SHALL BE 1 1/4"

NON-PORTLAND CONCRETE CEMENT CURB BOX (SEE DIMENSIONS BELOW), SHALL BE FURNISHED WITH COVER (AS SHOWN ABOVE), AS A UNIT.

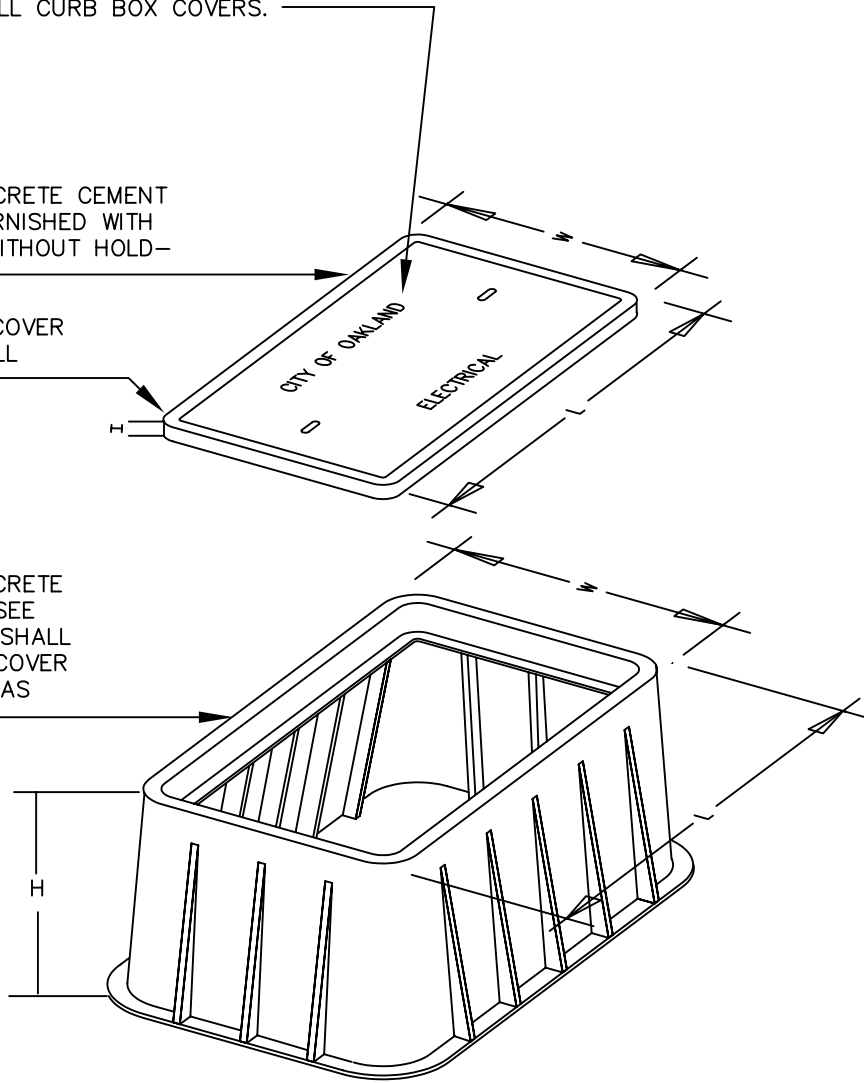


TABLE OF DIMENSIONS											
DIMENSIONS ARE IN INCHES AND SHOW THE ACCEPTABLE LIMITS											
CURB BOX & COVER SIZE NO.	CURB BOX						CURB BOX COVER				
	LENGTH		WIDTH		HEIGHT		LENGTH		WIDTH		HEIGHT
	MIN.	MAX.	MIN.	MAX.	MIN.	MAX.	MIN.	MAX.	MIN.	MAX.	
5	23 5/8"	25 3/8"	14 1/8"	15 7/8"	12	14	23 1/8"	23 1/4"	13 5/8"	13 3/4"	2"
6	30 7/8"	33"	17 7/8"	19 5/8"	12	14	30 3/8"	30 1/2"	17 3/8"	17 1/2"	2"

NOTES: MINIMUM CURB BOX COVER WALL THICKNESS SHALL BE 3/8" AT FLAT AREAS BETWEEN RIBS. COVERS SHALL BE FLUSH WITH TOP OF BOX WHEN INSTALLED. THE MATERIAL SHALL BE CONCRETE COLOR.

NOTE: THIS PLAN IS NOT A LEGAL ENGINEERING DOCUMENT BUT AN ELECTRONIC DUPLICATE. THE SIGNED CITY OF OAKLAND STANDARD DETAILS FOR PUBLIC WORKS CONSTRUCTION IS AVAILABLE FOR PURCHASE FROM THE CONTRACT ADMINISTRATION DEPARTMENT.

CITY OF OAKLAND

DESIGN AND CONSTRUCTION SERVICES DEPARTMENT



PRECAST,
NON-CONCRETE,
STANDARD CURB BOXES

ELECTRICAL SERVICES MANAGER

DATE: OCT 95
REV. DATE: AUG 99

DRWG.

E-9